


ALOHA SYSTEM - WIRING DIAGRAM (Typical)

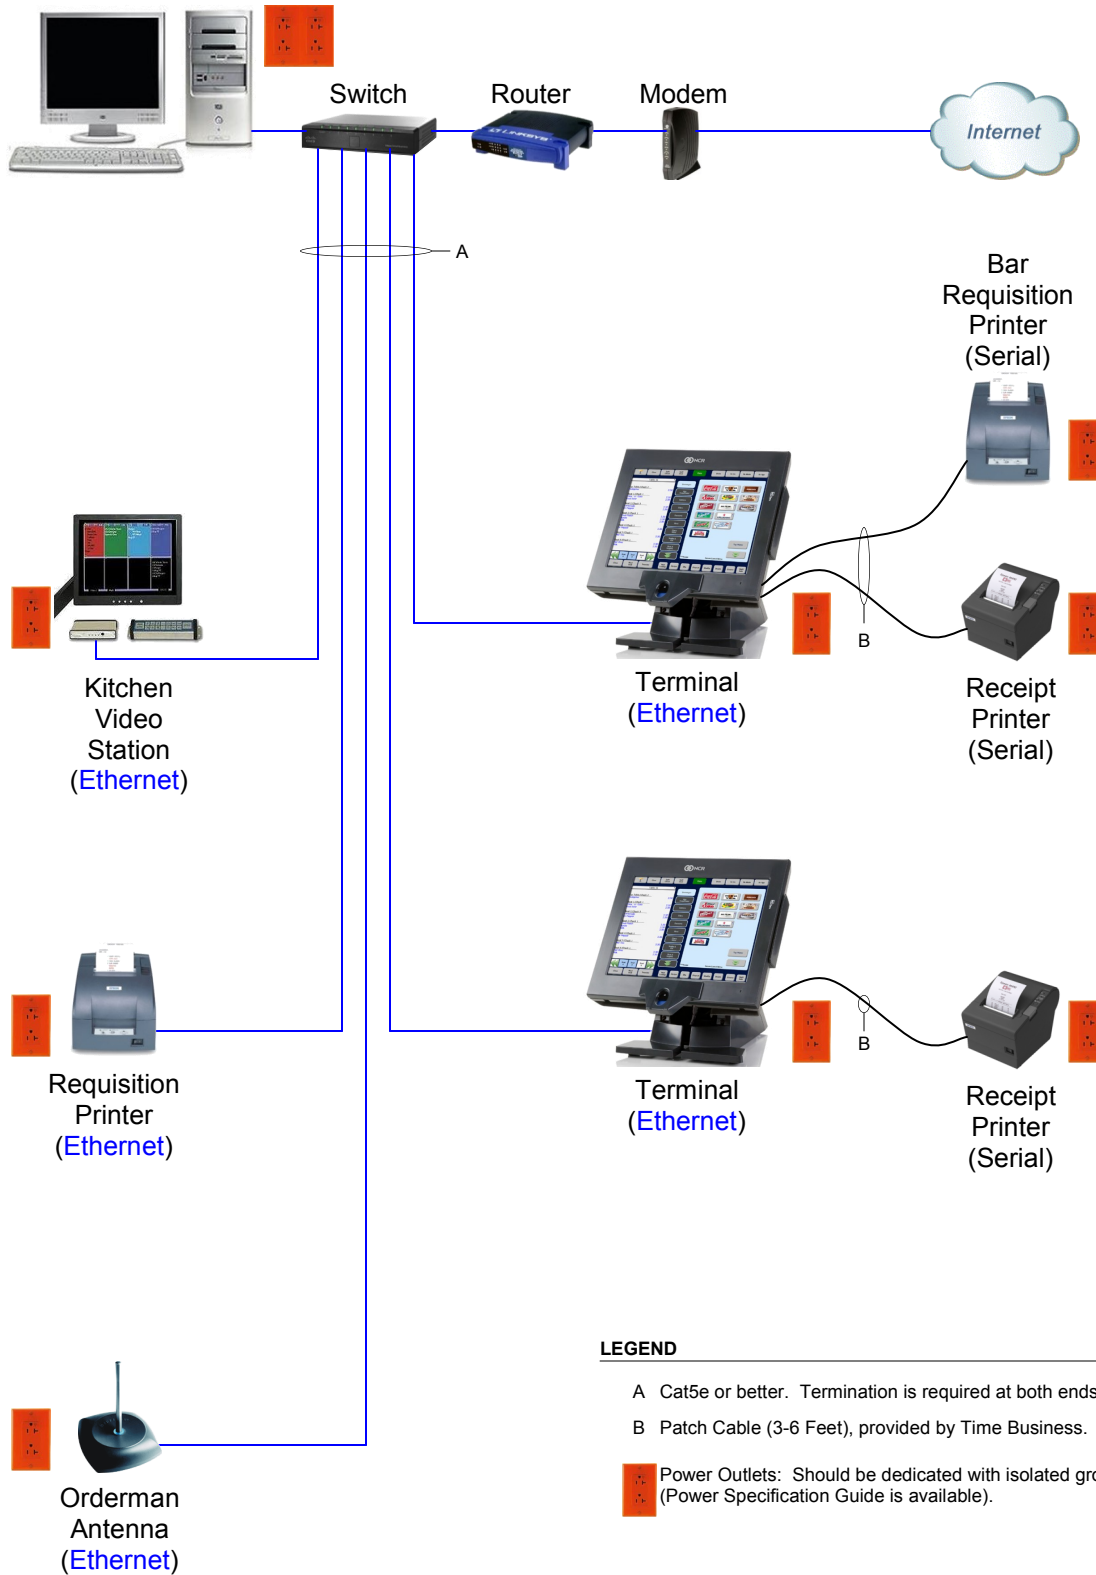

LEGEND

- A Cat5e or better. Termination is required at both ends. Test.
- B Patch Cable (3-6 Feet), provided by Time Business.
- Power Outlets: Should be dedicated with isolated ground (Power Specification Guide is available).

NOTES

1. Terminals: Each should have a UPS.
2. Requisition Printers (Serial): Preference is to have each controlled by a separate Terminal.